



- True RMS @1024 Samples/Cycle
- IEC 62053-22 Class 0.2S Compliant
- IEC 61000-4-30 Ed. 3.1 Class A Certified
- IEC 61000-4-15 Flickermeter
- PQ Disturbance Detection
- Disturbance Waveform Recording
- Comprehensive SDR and Energy Logs
- Dual Ethernet and 2xRS-485
- Modbus RTU/TCP, HTTPS, SNTP, SMTPS
- Extended Temperature Range
- Extended Warranty
- 7" TFT Color Dot-Matrix LCD Display
- 8GB Log Memory
- EN50160 & IEEE Std 519-2022 Report
- IEC 61000-4-7 Harmonics/Interharmonics
- ½ cycle RMS Recorder
- WF Recording in COMTRADE format
- 2kHz -150kHz C. E. Measurements
- IEC 61850 Support
- Optional Split-Core Current Probes
- Industrial Grade Components
- Standard Tropicalization

Designed For Reliability

Manufactured To Last



Advanced Power Quality Analyzer



Power Quality Metering

PQ Parameters as per IEC 61000-4-30 Ed. 3.1 Class A Certified

- Power Frequency
- Magnitude of the Supply Voltage and Current
- Flicker
- Supply Voltage Dips, Swells and Interruptions
- Supply Voltage Unbalance and Current Unbalance
- Mains Signaling Voltage on the Supply Voltage
- Rapid Voltage Changes
- Measurement of Over Deviation and Under Deviation Parameters
- Harmonics and Interharmonics for Voltage and Current
- 2kHz to 150kHz Conducted Emission Measurements

Harmonic and Interharmonic Measurements

- K-Factor for Current, Crest Factor for Current and Voltage
 - U and I THD, TOHD, TEHD, TIHD, TOIHD, TEIHD and TH (RMS)
 - U and I Individual Harmonics (%HD and RMS) from 2nd to 63rd#
 - U and I Individual Interharmonics (%IHD and RMS) from 1st to 63rd#
 - Total Harmonic P, Q, S and PF
 - Harmonic P, Q, S and PF from 2nd to 63rd in RMS
 - Harmonic Phase Angle from 2nd to 63rd#
 - U and I DC Components
 - Total Harmonic kWh, kvarh Import/Export/Net/Total
 - Total Harmonic kWh, kvarh Import/Export from 2nd to 63rd
- #%HD and %IHD can be configured as % of Fundamental, % of U/I nominal or % of RMS

Conducted Emissions in the 2kHz to 150kHz Range

- Real-time amplitude (150/180-Cycle) and the Max., Min., Avg. and CP95 (in 1-minute interval) for a total of 106 frequency segments for the 2kHz-9kHz (U_{rms} and I_{rms}) and 9kHz -150kHz (U_{rms}) range
- Daily Heat Map display on the Web Interface for the Max., Min., Avg. and 95th percentile values

Sequence and Unbalance

- Zero, Positive and Negative Sequence Components
- U and I Unbalance based on Zero and Negative Sequence Components

Dips, Swells, Interruptions Recording

- Dips, Swells & Interruptions detection @ 10ms (½ cycle at 50Hz)
- Trigger for DO, SOE Log, DR, WFR, DWR, RMSR, iTrigger and Alarm Email
- Display of Event specific WFR, DWR and/or RMSR as well as the associated ITIC/SEMI F47 plot on the Front Panel and Web Interface
- ITIC/SEMI F47 Alarm trigger for DO and iTrigger upon the detection of Dips, Swells and Interruptions that are outside of the respective tolerance curves

Transients Recording

- Transients capture as short as 20us @ 50Hz or 16.67us @ 60Hz at 1024 samples for sub-cycle disturbance such as capacitor switching and resonance phenomena
- Display of Event specific WFR, DWR and/or RMSR on the Front Panel and Web Interface

Rapid Voltage Changes (RVC)

- Detection of a quick transition in RMS voltage between two steady-state Voltage conditions

Inrush Current Monitoring

- Monitoring of the ½ cycle RMS Current and capturing of the Current waveforms associated with events such as motor starting and transformer being energized

Disturbance Direction Indicator

- Determine if a Dip/Swell/Interruption Event is located upstream or downstream
- Pinpoint if the cause of the event is external or internal

PQ Event Counters

- Dips, Swells, Interruptions, Transients, Rapid Voltage Changes, Inrush Current, Mains Signalling Voltages and Total PQ Event Counters

The iMeter 8 is CET's Advanced PQ Analyzer designed for the compliance monitoring market as it offers un-surpassed functionality by combining Class 0.2S accuracy and advanced PQ features in a 192x192x182.4mm housing with a High-Resolution, Color Dot-Matrix LCD display. The iMeter 8 complies with such standards as IEC 62053-22 Class 0.2S, IEC 61000-4-30 Ed. 3.1 Class A, IEC 61000-4-15, IEC 61000-4-7, EN50160, IEEE Std 519-2022 as well as IEC 61850 for Substation Automation. Further, it offers a large logging capacity with 8GB of on-board memory, extensive I/O, multiple Time Sync. methods, 2x100BaseT Ethernet and 2xRS-485 ports. In addition, it optionally provides 2xAO and 2xAI for different applications. These features likely make the iMeter 8 one of the most advanced PQ Analyzer for an intelligent Power Quality Monitoring System.

Typical Applications

- PQ monitoring at HV, MV and LV Utility Substations
- Data Centers, Semiconductor Fabs, Heavy Industries
- 7x24 Automated Manufacturing Facilities
- Dips, Swells, Interruptions, Transients, Flickers and Harmonics Monitoring
- Mains and Critical Feeder Monitoring
- IEC 61850 support for Substation Automation and Smart Grid
- Retrofit applications with Split-Core Current Probe (SCCP)

Basic Features

- IEC 62053-22 Class 0.2S kWh metering with Multi-Tariff TOU
- True RMS @ 1024 samples/cycle sampling
- 8GB on-board log memory
- 7" High-Resolution Color Dot-Matrix Display @ 800x480
- Time Sync. via SNTP, IEEE 1588 (PTP), IRIG-B or GPS 1PPS output
- 256 Standard Setpoints and 16 High-Speed Setpoints
- Dual 100BaseT Ethernet and two RS-485 ports

Power Quality Features

- IEC 61000-4-30 Ed. 3.1 Class A Certified
- IEC 61000-4-15, IEC 61000-4-7 Compliance
- 2kHz to 150kHz Conducted Emission Measurements
- Disturbance Direction Indicator
- Disturbance Waveform Recording and RMS Recording
- EN50160 and IEEE Std 519-2022 Reporting
- Fault Capture up to 2,000V peak to peak
- Waveform Recording in COMTRADE and PQDIF file format (Compatible with the PQ View software)

Front Panel Display and Web Interface

- True RMS Real-time, Harmonics, Power and Energy Measurements
- Demands and Multi-Tariff TOU
- Max. & Min. Logs
- Sequence & Unbalance
- Real-time WF Capture of 3-phase Voltages and Currents
- Event Waveforms, RMS Recording and ITIC/SEMI F47 Curves
- Harmonics & Interharmonics Histogram and Phasor Diagrams
- Device and SOE Logs, PQ Counters, Audit Logs and I/O Status
- Device Configuration and Diagnostics

Designed For Reliability

Manufactured To Last



Advanced Power Quality Analyzer

Metering

Basic Measurements (1-second update)

- 3-phase U, I, P, Q, S and PF as well as U4, I4 and I5
- kWh, kvarh Import/Export/Net/Total and kVAh Total
- Frequency

High-Speed Measurements

- 3-phase U, I, P, Q, S and PF as well as U4, I4 and I5 @ ½ cycle
- Frequency @ 1 cycle

Demands

- Present and Predicted Demand for 3-phase U, I, P, Q, S and PF as well as U4, I4, I5, Frequency
- Present Demand of 4-phase U & I THD/TOHD/TEHD, 4-phase Current K-Factor, U/I Unbalance, Over & Under Deviation of Voltage and Frequency, 4-phase Fundamental Current
- Max./Min. values per Demand Interval
- Maximum Demands for This Month & Last Month (or Since Last Reset & Before Last Reset)
- Demand Synchronization with DI

Multi-Tariff TOU capability

- Two independent sets of TOU Schedules, each supporting
 - Up to 12 Seasons
 - 90 Holidays or Alternate Days and 3 Weekdays
 - 20 Daily Profiles, each with 12 Periods in 15-minute interval
 - 8 Tariffs, each providing the following information:
 - kWh/kvarh Import/Export and kVAh
 - P & Q Import/Export Maximum Demands with timestamp
 - Register rollover at 100,000,000,000.000 kWh
- Switching between two TOU schedules manually or according to pre-programmed time
- 12 Historical Logs for Energy and Maximum Demand

Data and Event Recorders

Non-Volatile Log Memory

- 8GB on-board non-volatile Log Memory

Data Recorder (DR)

- 8 DR Logs capable of recording up to 64 parameters each
- Recording Interval from 1s to 40 days
- Programmable sources such as RMS/Fundamental/Harmonic/Interharmonic Measurements, Demands, Deviations, MSV, Unbalances and Flicker
- Configurable Recording Offset
- Support FIFO or Stop-When-Full recording modes

Statistical Data Recorder (SDR)

- 16 SDR Logs of maximum 64 parameters each
- Recording of the Max., Min., Avg. and CP95 for Real-time Measurements including U, I, P, Q, S, PF, Freq., Power, PF, Harmonics, Deviations and Unbalances
- Recording interval from 0 minute to 60 minutes
- 30 days @ 1-minute, 300 days @ 10-minute, 450-day @ 15-minute
- PQDIF file format, downloadable from the on-board FTP Server
- Support FIFO or Stop-When-Full mode

Interval Energy Recorder (IER) and Accumulative Energy Recorder (AER)

- Both IER and AER support recording of Total RMS kWh, kvarh Import/Export/Total/Net and kVAh, Total Fundamental and Total Harmonic kWh, kvarh Import/Export
- Recording interval from 1 minute to 65535 minutes
- Maximum Recording Depth @ 65535 records
- Support FIFO and Stop-When-Full modes

Max./Min. Recorder (MMR)

- 4 Max./Min. Recorders of 20 parameters each
- RMS/Fundamental/Harmonic/Interharmonic Measurements, Demands, Deviations, Unbalances and Flicker
- Two transfer modes:
 - Manual: Max./Min. Since Last Reset & Before Last Reset
 - Auto: Max./Min. of This Month & Last Month

iTrigger

- Cross trigger DO, SOE Log, WFR, DWR, RMSR and Alarm Email with other iMeter devices within the same local area network (LAN)
- Programmable via Web Interface or Communications

Real-Time Waveform Capture (WFC) and Waveform Recorder (WFR)

- Real-time WFC @ 128 samples/cycle x 4 cycles via Front Panel and Web Interface
- WFR with maximum 128 entries
- Simultaneous capture of 4-phase Voltage and Current Inputs
- No. of Cycles x Samples/Cycles with programmable pre-fault cycles: (40-400) x 1024, (40-800) x 512, (40-1600) x 256, (40-3200) x 128
- Scheduled WFR with maximum repetition of 10,000 times and programmable schedule from 1 to 1440 mins
- COMTRADE file format, downloadable from the on-board Web Server or FTP Server

Disturbance Waveform Recorder (DWR)

- 128 entries
- Simultaneous recording of all Voltage (U1-U4) and Current (I1-I4) Inputs
 - Initial Fault: 35 cycles @ 512 samples/cycle
 - Extended Fault: Up to 150 cycles @ 16 samples/cycle
 - Steady State: Up to 360s of 1-cycle absolute peak values
 - Post Fault: 15 cycles @ 512 samples/cycle

RMS Recorder (RMSR)

- 128 entries
- 16 parameters max., selectable U, I, P, Q, S, PF, Freq., Freq. Deviation
- Recording Interval from 0.5 to 60 cycles
- Recording Depth @ 7200 samples per parameter
- Configurable pre-fault samples from 100 to 500
- 72 seconds of ½ cycle RMS Recording @ 50Hz or 60 seconds @ 60Hz
- Display of U & I RMSR triggered by events on the Web Interface

SOE Log

- 1024 FIFO events time-stamped to ±1ms resolution
- Setpoint events, I/O operations, Dips, Swells, Interruptions, Transients, Rapid Voltage Changes, Inrush Current, Mains Signaling Voltages, Motor Start, iTrigger, etc.
- Record the time and characteristic data for Setpoints and PQ events

Device Log

- 1024 FIFO entries time-stamped to ±1ms resolution
- Power On/Off Records, Setup changes, Time Sync., Device Operations and Self-diagnostics

Audit Logs

- Display of Log In/Out events, View/Export/Clear Audit Logs on the Web Interface for Auditor Account
- Store up to 2048 Audit Logs in non-volatile memory
- Support FIFO or Stop-When-Full recording modes

IEEE Std 519-2022 Report

- 365 Daily Reports for statistical evaluations on Voltage and Current Harmonics based on 99th percentile very short time (3s) values
- 52 Weekly Reports for statistical evaluations on Voltage Harmonics (95th percentile) and Current Harmonics (95th and 99th percentile) short time (10 min) values
- Configurable Report Mode, PCC Voltage, Max. Short Circuit Current, etc.

Setpoints

PQ Setpoints

- Transients
- Dips, Swells, Interruptions, ITIC Alarm and SEMI F47 Alarm
- Rapid Voltage Changes
- Inrush Current
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

Control Setpoints

- 256 standard and 16 High-Speed Setpoints
- Extensive monitoring sources including U, I, P, Q, S, Demand, Harmonics, Unbalances, Deviations, Flickers, Phase Reversal/Loss, AI, etc.
- Configurable thresholds and time delays
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

Motor Start Setpoints

- Monitoring motor startup procedure with recording of Max. Starting Current, Minimum Voltage and Duration
- Trigger DO, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

Designed For Reliability

Manufactured To Last



Digital Input Setpoints

- Provides control output actions in response to changes in Digital Input status
- Trigger DO, DR, SOE Log, WFR, DWR, RMSR, iTrigger and Alarm Email

Inputs and Outputs

Digital Inputs

- Standard 8 or optional 16 channels
- Standard volt free dry contact with 24VDC Internal Excitation
- Optional 110VAC/DC or 220VAC/DC External Excitation
- 1000Hz sampling for external status monitoring with programmable debounce
- Pulse counting with programmable weight for each channel for collecting WAGES (Water, Air, Gas, Electricity, Steam) information
- Demand Synchronization and Tariff Switch based on DI Status

Digital Outputs

- Standard 3 or optional 7 channels Form A and 1 channel Form C
- Mechanical Relays for general purpose control or alarming
- Optional 2 or 4 SS Relays for Energy pulsing applications

Analog Inputs (Optional)

- Two channels 0/4-20mA DC input with programmable zero and full scales that can be used to measure external transducer signal

Analog Output (Optional)

- One or two channels 0/4-20mA DC output with programmable zero and full scales

Communications

Ethernet Ports (P1, P2)

- Dual 10/100BaseT Ethernet Ports with RJ45 connector
- Protocols supported: Modbus TCP, HTTPS, SNMP, SMTPS, FTP and IEC 61850
- Built-in password protected Web Server with multiple user accounts and pre-defined roles for easy data viewing, setup configuration and firmware upgrade
- Simultaneous client connections for 12xModbus TCP & 12xIEC 61850

RS-485

- Dual optically isolated RS-485 port with baud rate from 1.2 to 38.4 kbps
- Support Modbus RTU and Ethernet Gateway

Time Synchronization

- Battery-backed Real-time clock @ 6ppm ($\leq 0.5s/day$)
- Time Sync. via Modbus RTU/TCP, SNMP, IEEE 1588 (PTP)
- Optional GPS/IRIG-B Input

System Integration

PecStar® iEMS

- The iMeter 8 is supported by CET's PecStar® iEMS
- In addition, the iMeter 8 can be easily integrated into other 3rd party systems because of its support of multiple communications ports as well as different industry standard protocols such as Modbus and IEC 61850


DiagSys

- Display of Real-time Measurements, PQ Events, Waveforms and Statistical Trend Charts
- Export of IER, AER and SDR Logs as well as EN 50160 Reports
- Generation and Export of self-defined PQ Analysis Reports


3rd Party System Integration

- Easy integration into Substation Automation or Utility SCADA systems via Modbus RTU, Modbus TCP or IEC 61850
- The on-board, password-protected Web Server provides user-friendly access to its data and supports the configuration for most Setup parameters via a web browser without the use of proprietary software
- The on-board, password protected FTP Server allows Excel files for the logged C.E. Measurement data, IEEE Std 519-2022 Daily and Weekly reports and waveform records in COMTRADE format as well as PQDIF files to be downloaded without any special software. The downloaded files can be subsequently viewed using software that supports the industry standard PQDIF and COMTRADE file formats


Typical Wiring Diagrams

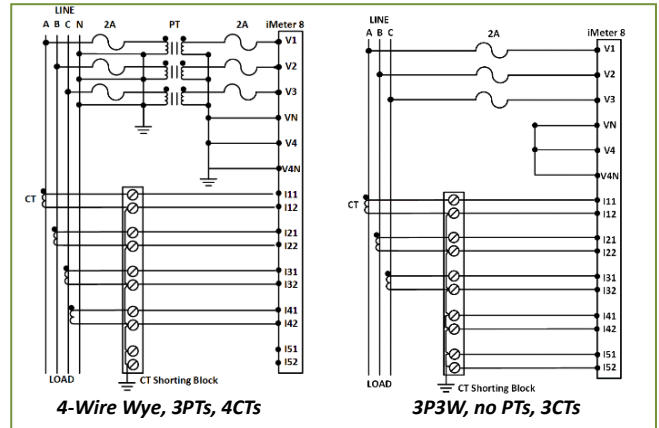


Device Views and Mounting Diagram

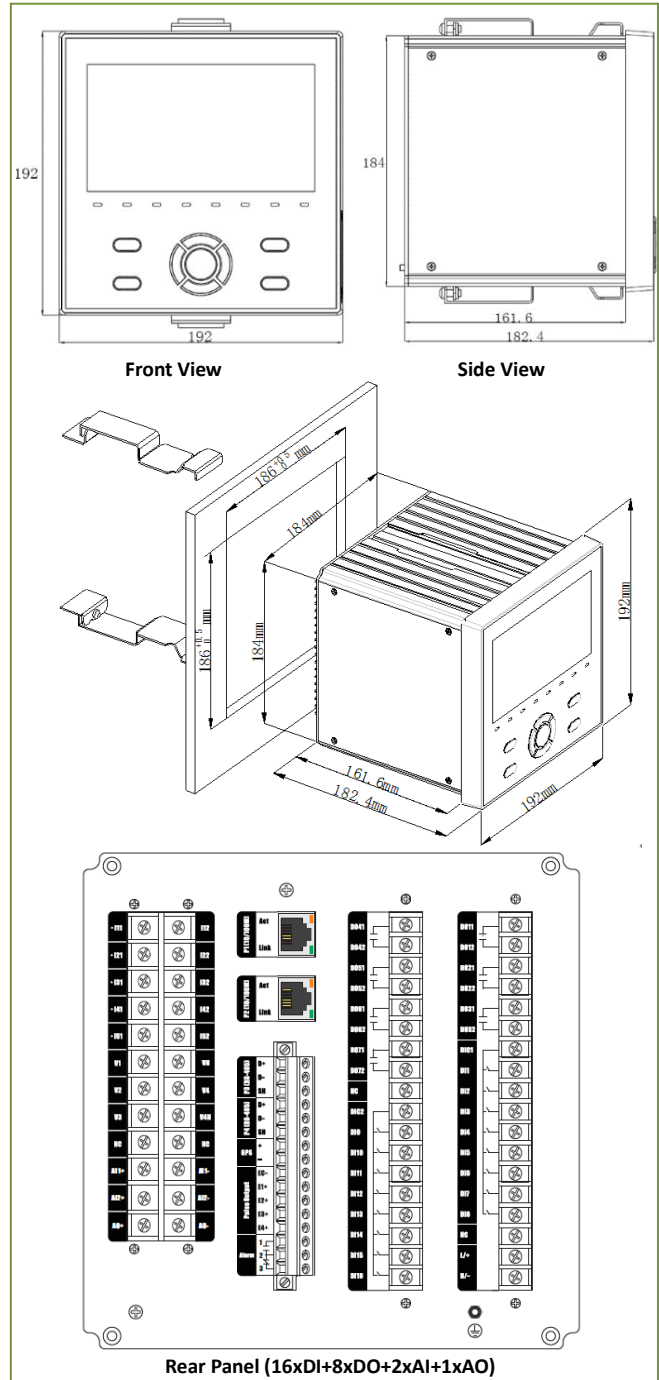

Front Panel User Interfaces

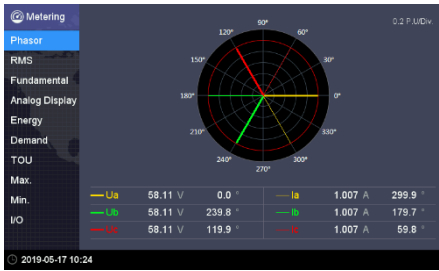


Phasor Diagram

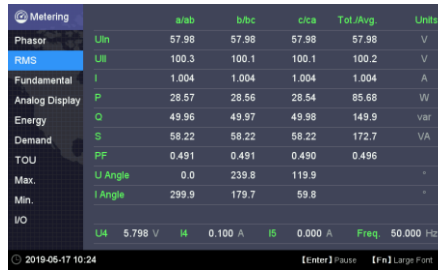


Phasor	Ulin	57.98	57.98	57.98	57.98	V
RMS	Ull	100.3	100.1	100.1	100.2	V
Fundamental	I	1.004	1.004	1.004	1.004	A
Analog Display	P	28.57	28.56	28.54	85.68	W
Energy	Q	49.96	49.97	49.98	149.9	var
Demand	S	58.22	58.22	58.22	172.7	VA
TOU	PF	0.491	0.491	0.490	0.496	
Max.	U Angle	0.0	239.8	119.9		
Min.	I Angle	299.9	179.7	59.8		
I/O	U4	5.798 V	I4	0.100 A	I5	0.000 A
					Freq.	50.000 Hz

RMS

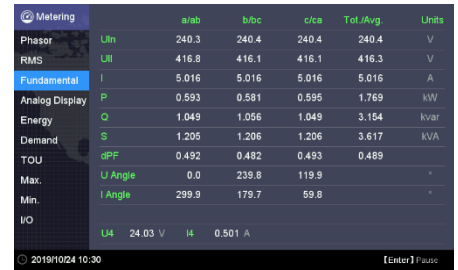

Phasor	Ulin	240.3	240.4	240.4	240.4	V
RMS	Ull	416.8	416.1	416.1	416.3	V
Fundamental	I	5.016	5.016	5.016	5.016	A
Analog Display	P	0.593	0.581	0.595	1.769	kW
Energy	Q	1.049	1.056	1.049	3.154	kvar
Demand	S	1.205	1.206	1.206	3.617	kVA
TOU	dPF	0.492	0.482	0.493	0.489	
Max.	U Angle	0.0	239.8	119.9		
Min.	I Angle	299.9	179.7	59.8		
I/O	U4	24.03 V	I4	0.501 A		

Fundamental Measurement

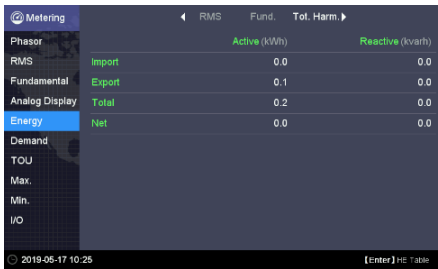

Phasor	Active (kWh)	Reactive (kvarh)
RMS	Import	0.0
Fundamental	Export	0.1
Analog Display	Total	0.2
Energy	Net	0.0
Demand		0.0
TOU		
Max.		
Min.		
I/O		

Energy Display




T1 Energy
kWh Imp. 11.9
kWh Exp. 0.0
kvarh Imp. 20.9
kvarh Exp. 0.0
kVAh 24.1

Large Character TOU Energy Display




Harmonics

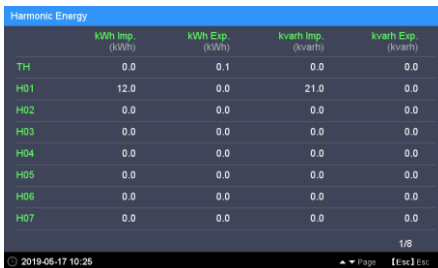


	kWh Imp. (kWh)	kWh Exp. (kWh)	kvarh Imp. (kvarh)	kvarh Exp. (kvarh)
TH	0.0	0.1	0.0	0.0
H01	12.0	0.0	21.0	0.0
H02	0.0	0.0	0.0	0.0
H03	0.0	0.0	0.0	0.0
H04	0.0	0.0	0.0	0.0
H05	0.0	0.0	0.0	0.0
H06	0.0	0.0	0.0	0.0
H07	0.0	0.0	0.0	0.0

Harmonic Energy Measurements

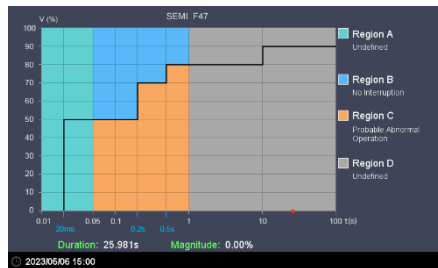


SEMI F47 Plot

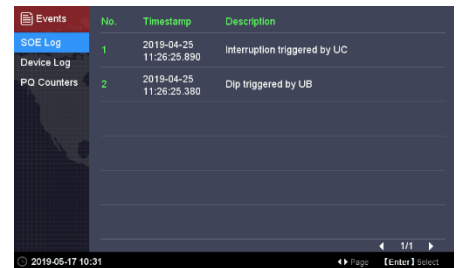

No.	Timestamp	Description
1	2019-04-25 11:26:25.890	Interruption triggered by UC
2	2019-04-25 11:26:25.380	Dip triggered by UB

Events




Harmonic	Ua Over Dev.	0.00 %	Uab Over Dev.	0.00 %
Interharmonic	Ub Over Dev.	0.00 %	Ubc Over Dev.	0.00 %
Deviation	Uc Over Dev.	0.00 %	Uca Over Dev.	0.00 %
Unbalance	Ua Under Dev.	1.59 %	Uab Under Dev.	1.72 %
Flicker	Ub Under Dev.	1.59 %	Ubc Under Dev.	1.89 %
EN50160	Uc Under Dev.	1.59 %	Uca Under Dev.	1.88 %
	Freq. Dev.	0.000 Hz		

Deviation




No.	Power Quality Parameters	Conclusion
01	Power Frequency	✗
02	Supply Voltage Variations	✗
03	Rapid Voltage Changes	✓
04	Flicker Severity	✓
05	Supply Voltage Unbalance	✓
06	Harmonic Voltages	✓
07	Interharmonic Voltages	✓
08	Mains Signalling Voltages	✓
09	Interruptions of the Supply Voltage	✗
10	Supply Voltage Dips	✗
11	Supply Voltage Swells	✗
12	Transient Overvoltages	✗

EN 50160 Report

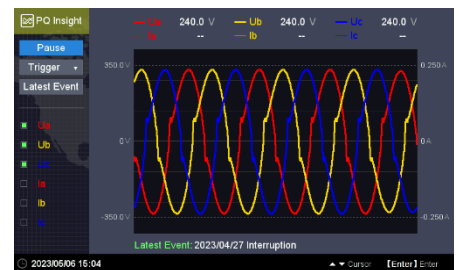


Real-Time WF Capture

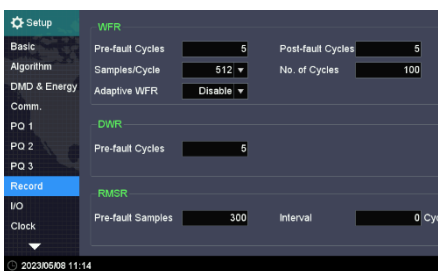


Record Setup screen showing WFR and RMSR settings. WFR: Pre-fault Cycles 5, Post-fault Cycles 5, Adaptive WFR Disable. RMSR: Pre-fault Samples 300, Interval 0 Cyc.

Record Setup

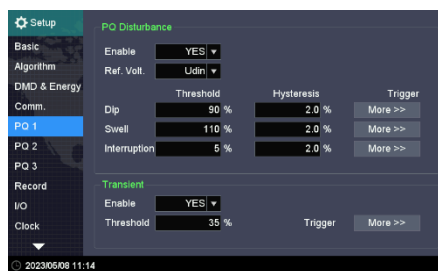

PQ 1 Setup screen showing PQ Disturbance settings. Enable YES, Ref. Volt. Udin, Threshold 90%, Hysteresis 2.0%, Trigger More >>.


PQ 1 Setup

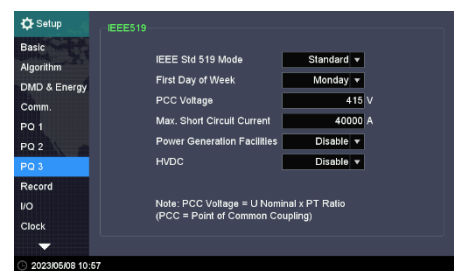


IEEE Std 519-2022 Report Setup screen showing IEEE519 settings. IEEE Std 519 Mode Standard, First Day of Week Monday, PCC Voltage 415 V, Max. Short Circuit Current 40000 A, Power Generation Facilities Disable, HVDC Disable.

IEEE Std 519-2022 Report Setup


Web Interfaces

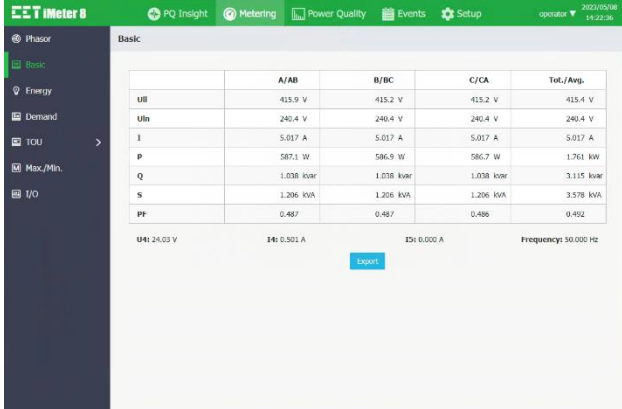


Basic Measurements

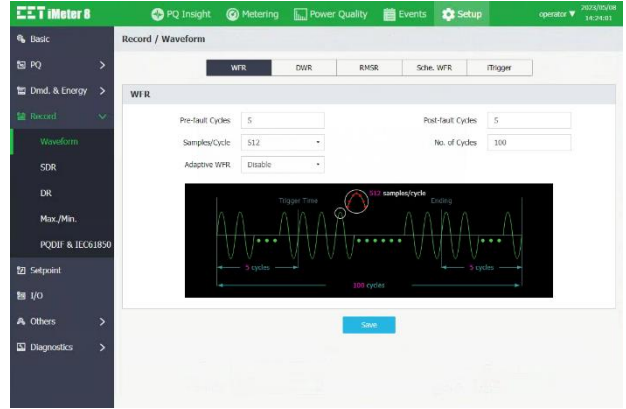

WFR Setup

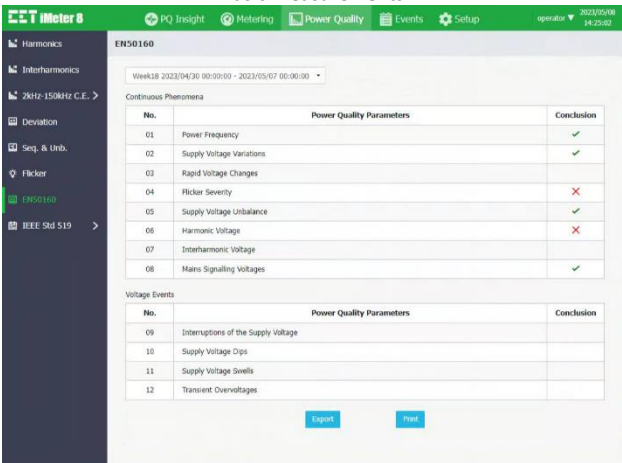

EN 50160 Report

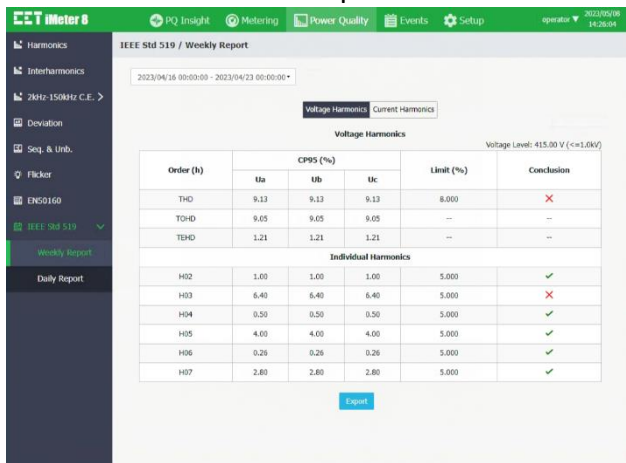

IEEE Std 519-2022 Weekly Voltage Harmonic Compliance Report

Dip


Event Timestamp: 2023/05/08 12:12:04.707
 Waveform Trigger Time: 2023/05/08 12:12:04.707
 Source: Ua Magnitude: 79.99%, 99.99%, 99.99% Duration: 100ms Direction: Upstream Confidence: Low



RMSR Plot

Dip


Event Timestamp: 2023/05/08 12:12:04.707
 Waveform Trigger Time: 2023/05/08 12:12:04.707
 Source: Ua Magnitude: 79.99%, 99.99%, 99.99% Duration: 100ms Direction: Upstream Confidence: Low

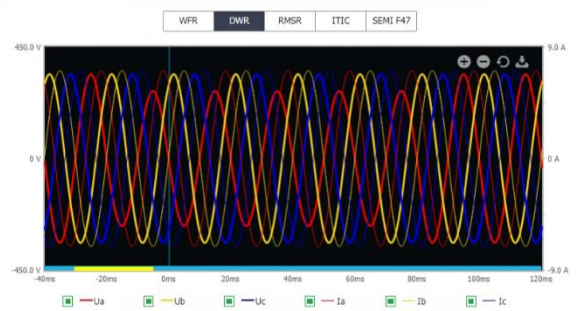

Disturbance Waveform

Dip


Event Timestamp: 2023/05/08 12:12:04.707
 Waveform Trigger Time: 2023/05/08 12:12:04.707
 Source: Ua Magnitude: 79.99%, 99.99%, 99.99% Duration: 100ms Direction: Upstream Confidence: Low

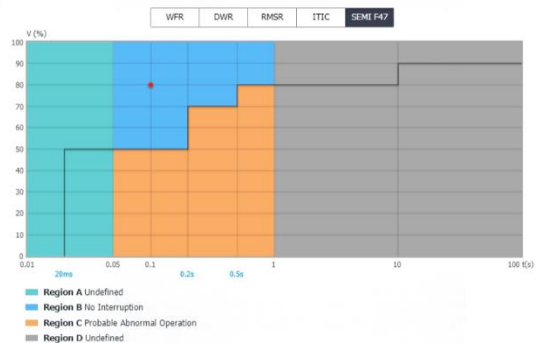

SEMI F47 Plot

Dip

Event Timestamp: 2023/05/08 12:12:04.707
 Waveform Trigger Time: 2023/05/08 12:12:04.707
 Source: Ua Magnitude: 79.99%, 99.99%, 99.99% Duration: 100ms Direction: Upstream Confidence: Low

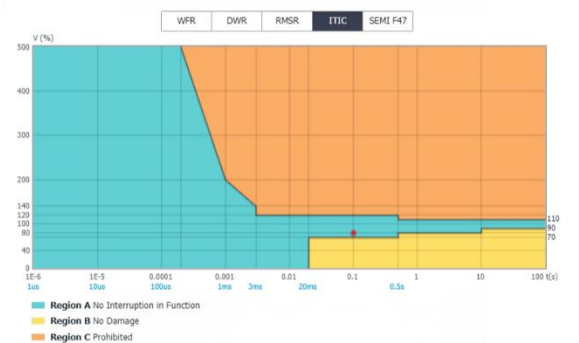

ITIC Plot



Technical Specifications

Voltage Inputs (V1, V2, V3, VN, V4, V4N)	
Standard (Un)	400ULN/690ULL +20%
Range	1% to 200% Un for 400ULN nominal
Overload	2xUn continuous, 4xUn for 1s
Burden	< 0.5VA/per phase
PT Ratio	
Primary	1-1,000,000V
Secondary	1-1,500V
V4 Primary	1-1,000,000V
V4 Secondary	1-1,500V
Measurement Category	CAT III 1000V
Frequency	40Hz-60Hz @ 50Hz, 48Hz-72Hz @ 60Hz
Current Inputs (I11, I12, I21, I22, I31, I32, I41, I42, I51, I52)	
Standard (In)	5A (Standard), 1A (Optional)
Range	1% to 400% In
Starting Current	0.1% In
Overload	4xIn continuous, 20xIn for 1s
Burden	< 0.5VA/per phase @ 5A < 0.1VA/per phase @ 1A
Optional SCCP Options	Split-Core Current Probe Input @ 500mV
SCCP-50A-500mV	5A/50A (In/Imax), max. 500mV Output
SCCP-200A-200mV	20A/200A (In/Imax), max. 200mV Output
SCCP-500A-500mV	500A Imax, max. 500mV Output
SCCP-5000A-500mV	Selectable 500A/5000A (Imax) Rogowski Coil, max. 500mV Output
CT Ratio	
Primary	1-30,000A
Secondary	1-50A
I4 Primary	1-30,000A
I4 Secondary	1-50A
Power Supply (L+, N-)	
Standard	95-250VAC/VDC ± 10%, 47-440 Hz
Optional	20-60VDC
Burden	< 12W
Overvoltage Category	OVC III 300V
Digital Inputs (DIC, DI1 to DI8 or DI16)	
Standard	Dry contact, 24VDC internally wetted
Optional	110V/220V AC/DC externally wetted
Sampling	1000Hz
Hysteresis	1ms minimum
Form A Relay Outputs (DO1 to DO3 or optional DO1 to DO7)	
Type	Form A Mechanical Relay
Loading	5A @ 250VAC / 30VDC
Form C Relay Output (Alarm 1, 2, 3)	
Type	Form C Mechanical Relay
Loading	8A @ 250VAC / 24VDC
Pulse Outputs (E1+, E1-, E2+, E2-, E3+, E3-, E4+, E4-)	
Type	Form A Solid State Relay
Isolation	Optical
Max. Load Voltage	30VDC
Max. Forward Current	4mA
Optional Analog Inputs (AI1+, AI1-, AI2+, AI2-)	
Type	0-20 / 4-20 mA DC
Overload	24 mA maximum
Optional Analog Outputs (AO1+, AO1-, AO2+, AO2-)	
Type	0-20 / 4-20 mA
Loading	500Ω maximum
Overload	24 mA maximum
Environmental Conditions	
Operating Temperature	-25°C to 70°C
Storage Temperature	-40°C to 85°C
Humidity	5% to 95% non-condensing
Atmospheric Pressure	63 kPa to 110 kPa
Pollution Degree	2
Mechanical Characteristics	
Panel Cutout	186x186 mm
Unit Dimensions	192x192x182.4 mm
IP Rating	52

Standards of Compliance

Safety Requirements		
CE LVD 2014 / 35 / EU		EN 61010-1: 2010 EN 61010-2-030: 2010
Electrical Safety in Low Voltage Distribution Systems up to 1000Vac and 1500 Vdc		IEC 61557-12: 2018 (PMD)
Insulation		IEC 62052-11: 2003 IEC 62053-22: 2003 EN 61010-1: 2010
AC Voltage: 2kV @ 1 minute		
Insulation Resistance: >100MΩ		
Impulse Voltage: 6kV, 1.2/50µs		
EMC Compatibility		
CE EMC Directive 2014 / 30 / EU (EN 61326: 2013)		
Immunity (EN50082-2)		
Electrostatic Discharge		EN 61000-4-2: 2009
Radiated Fields		EN 61000-4-3: 2006+A1: 2008+A2: 2010
Fast Transients		EN 61000-4-4: 2012
Surges		EN 61000-4-5: 2014+A1: 2017
Conducted Disturbances		EN 61000-4-6: 2014
Magnetic Fields		EN 61000-4-8: 2010
Voltage Dips and Interruptions		EN 61000-4-11: 2004+A1: 2017
Ring Wave		EN 61000-4-12: 2017
Emission (EN50081-2)		
Limits and Methods of Measurement of Electromagnetic Disturbance Characteristics of Industrial, Scientific and Medical (ISM) Radio-Frequency Equipment		EN 55011: 2016
Limits and Methods of Measurement of Radio Disturbance Characteristics of Information Technology Equipment		EN 55032: 2015
Limits for Harmonic Current Emissions for Equipment with Rated Current ≤16 A		EN 61000-3-2: 2014
Limitation of Voltage Fluctuations and Flicker in Low-Voltage Supply Systems for Equipment with Rated Current ≤16 A		EN 61000-3-3: 2013
Emission Standard for Industrial Environments		EN 61000-6-4: 2007+A1: 2011
Mechanical Tests		
Vibration Test	Response	IEC 255-2-1: 1989
	Endurance	IEC 255-2-1: 1989
Shock Test	Response	IEC 255-2-2
	Endurance	IEC 255-2-2
Bump Test		IEC 255-2-2
Power Quality		
Voltage Characteristics of Electricity Supplied by Public Distribution Systems		EN 50160: 2010
General Guide on Harmonic and Interharmonic Measurements and Instrumentation, for Power Supply Systems and Equipment Connected Thereto		IEC 61000-4-7: 2009
Flicker Meter - Functional and Design Specifications		IEC 61000-4-15: 2010
Testing and Measurement Techniques - Power Quality Measurement Methods		IEC 61000-4-30: 2021 Ed. 3.1 Class A Certified
Power Quality Measurement in Power Supply Systems-Part 2: Functional Tests and Uncertainty Requirements		IEC 62586-2: 2021 Ed.2.1
Harmonic Control in Electrical Power systems		IEEE Std 519-2022



Accuracy

Parameters	Accuracy	Resolution
Voltage (U)	±0.1%	0.001V
I1, I2, I3	±0.1%	0.001A
I4	±0.1%	
I5	±0.5%	
P, Q, S	±0.2%	0.001kX
	SCCPA Option: ±0.5%	
kWh, kVAh	IEC 62053-22 Class 0.2S	0.1kXh
	SCCPA Option: IEC 62053-21 Class 1	
kvarh	IEC 62053-24 Class 0.5S	0.1kvarh
	IEC 62053-23 Class 2	
	SCCPA Option: IEC 62053-24 Class 1	
PF	±0.2%	0.001
	SCCPA Option: ±0.5%	
Frequency	±0.003 Hz	0.001Hz
Harmonics	IEC 61000-4-7 Class I	0.001
Phase Angle	±0.2°	0.1°
	SCCPA Option: ±0.2° + Phase Error of SCCP	
U Unbalance	±0.1 %	0.01%
I Unbalance	±0.5%	0.01%
Pst, Plt	IEC 61000-4-15 Class F1	0.01%

Ordering Guide

Product Code	Description
iMeter 8 Advanced Power Quality Analyzer	
Basic Feature	
A	1024 samples/cycle, 8GB On-Board Memory IEC 61000-4-30 Ed. 3.1 Class A Certified
B**	1024 samples/cycle, 8GB On-Board Memory IEC 61000-4-30 Ed. 3.1 Class A Certified with 2kHz-150kHz C.E. Measurement
Input Current	
5	5A
1	1A
SCCPA^	SCCP Option for use with CT Clamps with max. 500mV output.
Input Voltage	
9	400V LN/690V LL + 20%
Power Supply	
2	95-250VAC/DC ± 10%, 47-440Hz
3**	20-60VDC
System Frequency	
5	50Hz
6	60Hz
I/O	
A	8xDI + 4xDO + 4xSS Pulse Outputs
B**	8xDI + 4xDO + 2xAI + 1xAO + 4xSS Pulse Outputs
C*	16xDI + 8xDO + 4xSS Pulse Outputs
D**	8xDI + 4xDO + 2xAI + 2xAO + 2xSS Pulse Outputs
DI Excitation	
N	Dry Contact (@24VDC Self-Excitation)
1*	110V AC/DC External Excitation
2*	220V AC/DC External Excitation
Communications	
A	2x100BaseT + 2xRS-485
Time Sync.	
A	GPS, IRIG-B
Display Language	
E	English

iMeter 8 - A 5 9 Z 5 A N A A E iMeter 8-A59Z5ANAAE (Standard Model)


*Additional charges apply

**The I/O options "B" and "D" are not supported when the Basic Feature option "B" is selected.


^The SCCPA option is compatible with the SCCP models listed in the "SCCP Option" sheet. This option does not come with any Current Clamp. Please refer to the "SCCP Option" sheet for more information and order the desired model and quantity as a separate item.

*The DI Excitation options "1" and "2" are not supported when the Power Supply option "3" with 20-60VDC is selected.


Optional 50A, 200A, 500A and 5000A CATIII Split-Core Current Probes for Non-Intrusive Applications.

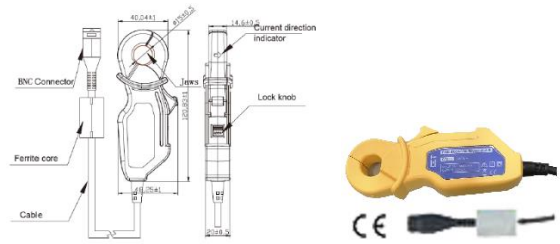


PMC-SCCP-50A-500mV

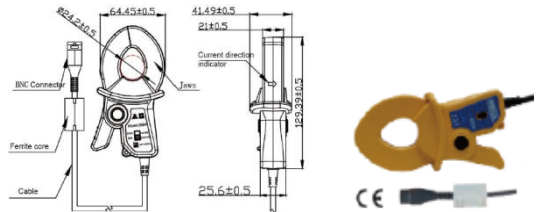

PMC-SCCP-200A-200mV

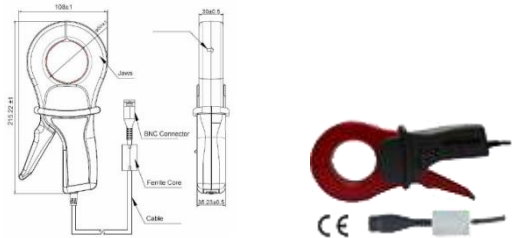

PMC-SCCP-500A-500mV

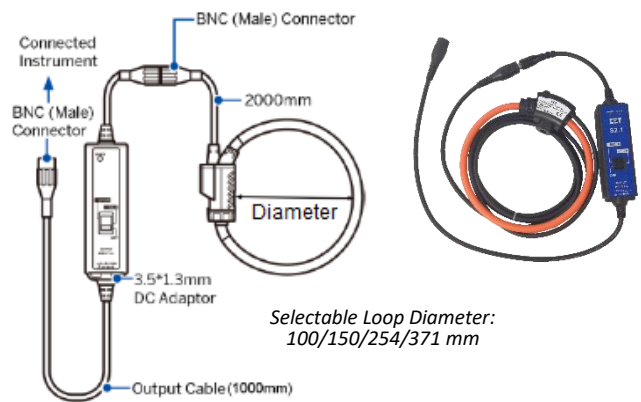

PMC-SCCP-5kA-500mV

Please refer to the Technical Specifications for more information about the SCCPs and Flexible Rogowski Coil.

Your Local Representative

CET Electric Technology Inc.

E: sales@cet-global.com

W: www.cet-global.com

Revision Date: May 22, 2023